



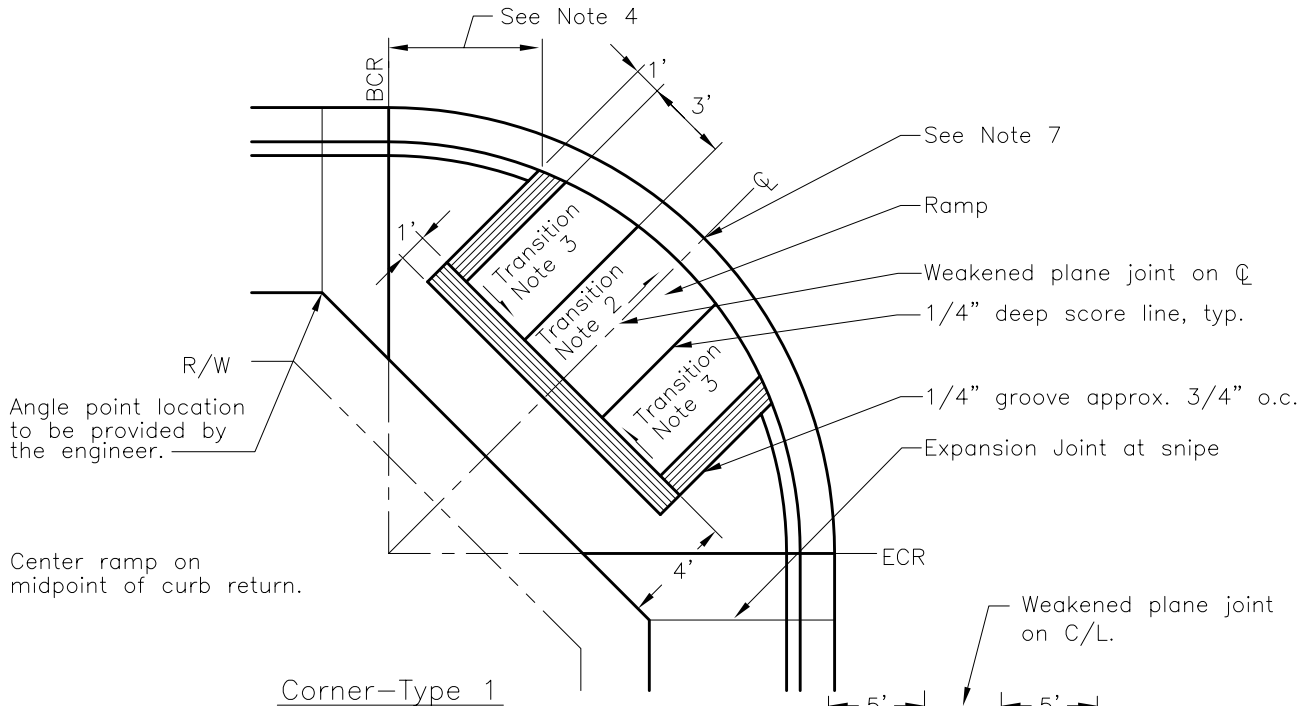

CITY OF LODI


PUBLIC WORKS DEPARTMENT

Type 5 Handicap Ramp

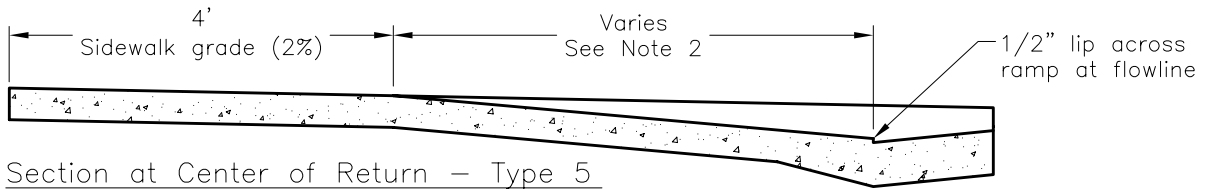

Notes:

1. Curb return radius as specified.
2. Ramp slope 1:12 maximum, 1:15 minimum.
3. Transition slope 1:10 maximum.
4. For 6" curb height, transition curb height to 4-1/2" from expansion joint to beginning of "transition".
5. See Std. Plan 611 for layout dimensions.
6. The concrete finish of the ramp shall have a transverse broomed surface texture rougher than the surrounding sidewalk.
7. The gutter pan across the route of travel from the ramp to the street shall have a maximum rise of 5%.

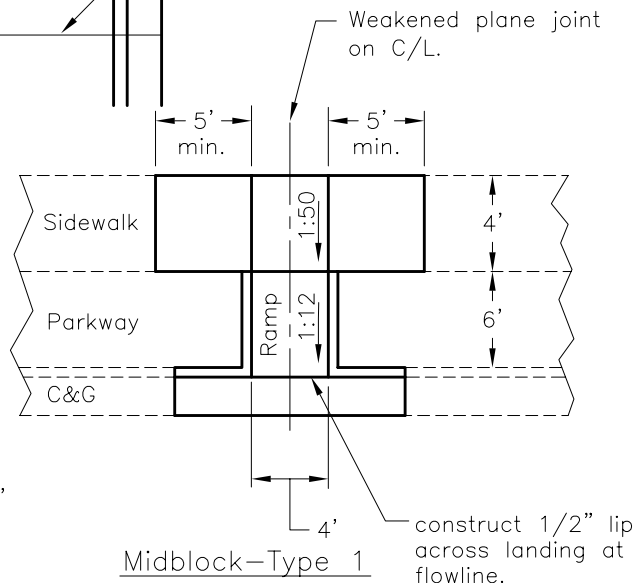

Dr. KT	No.	Date	Revision	Appr.	Approved By:	STD PLAN
Ch. WS	1	9/25	ADDED 1/2" LIP AT FLOWLINE		<i>F. Wally Sandelin</i>	132D
Date 12/00	2	2/04	REVISED MIDBLOCK LAYOUT		F. Wally Sandelin City Engineer R.C.E. 39895	
			REVISED BOW DIMENSION		2/12/02 Date	